







TENANT FIRE SAFETY DISCLOSURE INFORMATION

BUILDING ADDRESS: _____ FLOOR/LEVEL: _____

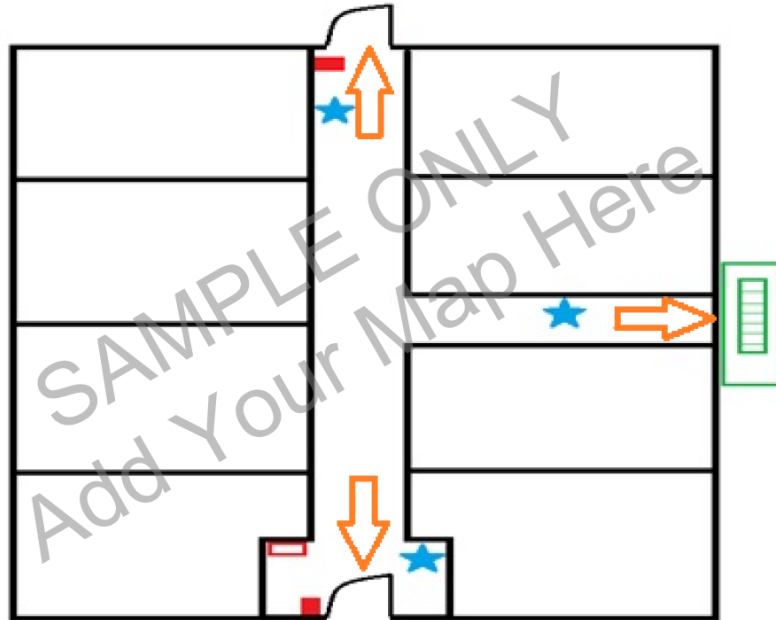

EXITS SHALL REMAIN UNOBSTRUCTED AT ALL TIMES

-  = EXIT
-  = FIRE EXTINGUISHER - Service Date: _____
-  = FIRE ALARM MANUAL PULL STATION (if applicable)
-  = FIRE ALARM CONTROL PANEL (if applicable) - Service Date: _____
UL Certification #: _____
UL Expiration Date: _____
-  = FIRE ESCAPE (if applicable) - Service Date: _____

SMOKE & CARBON MONOXIDE ALARM DEVICES:

TO CONFIRM ALARMS ARE IN WORKING CONDITION, PUSH "TEST" BUTTON ON EACH DEVICE

SMOKE ALARMS - Date Last Replaced in Unit: _____

CARBON MONOXIDE ALARMS - Date Last Replaced in Unit: _____

**TO REPORT A SUSPECTED FIRE CODE VIOLATION, CONTACT THE FIRE DEPARTMENT AT:
415-558-3300.**