




FLAME-LIGHTED CANDLES AND OTHER OPEN FLAME DECORATIVE DEVICES

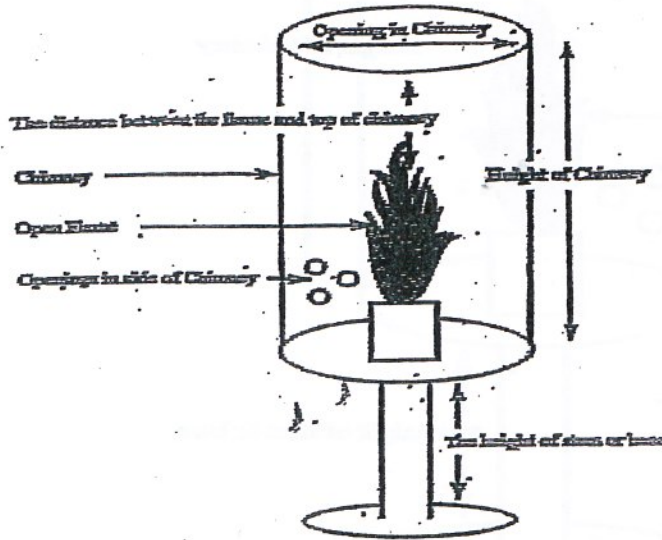

APPROVED FOR USE IN CONNECTION WITH ASSEMBLY AREAS, DINING AREAS OF RESTAURANTS OR DRINKING ESTABLISHMENTS IN THE CITY AND COUNTY OF SAN FRANCISCO FOR:

PERMIT ADDRESS: _____

PERMIT HOLDER: _____

DESCRIPTION OF CANDLE OR OPEN FLAME DEVICE:


Minimum Height of Chimney		Openings in sides of Chimney	
Maximum Width of the Openings of Top of Chimney		Minimum distance of flame to top of chimney	
Fuel: Combustible Liquid or Candle		Height of Stem or Base	

CONDITIONS OR RESTRICTIONS:

APPROVED CANDLES SHALL BE USED ON TABLES AND KIOSKS ONLY

APPROVAL DATE _____ PERMIT VALID FOR APPROVED CANDLE OR OPEN-FLAME DEVICE DESCRIBED ABOVE. WHEN A CHANGE OF OWNERSHIP OR CANDLE TYPE OCCURS A NEW PERMIT IS REQUIRED. A COPY OF THIS DOCUMENT SHALL REMAIN ON SITE AND AVAILABLE FOR REVIEW BY FIRE INSPECTOR.

FLAME-LIGHTED CANDLES AND OPEN FLAME DECORATIVE LIGHTING
(Illustrative purpose only; see requirements below.)

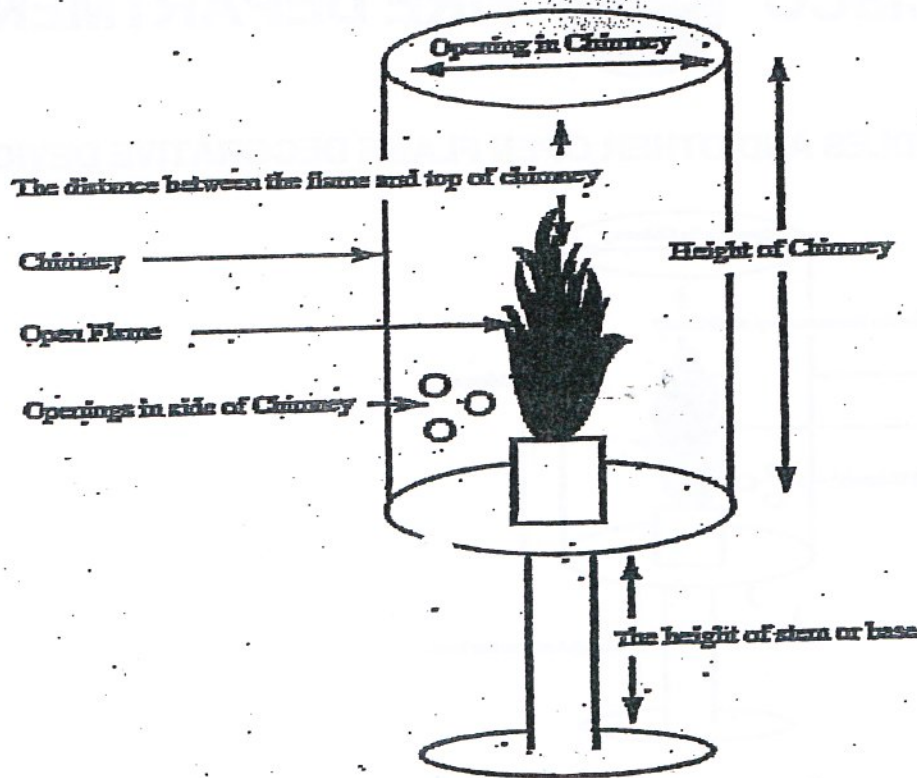

The use of candles and open flame decorative devices in connection with assembly areas, dining areas of restaurants and drinking establishments shall comply with the following requirements of the San Francisco Fire Code:

1. Class I and II liquids and liquefied petroleum gases (propane or butane) shall not be used as fuels.
2. The flame shall be enclosed in a noncombustible chimney. The candle or device may set in the chimney or the chimney may be securely attached to the device.
3. The distance between the openings on top of the chimney and the top of flame shall be such that a single layer of tissue paper placed on the top of the chimney will not ignite in 10 seconds.
4. Openings on the sides of the chimney shall not be more than 3/8 inch in diameter.
5. The candle holder or chimney shall be designed so that it will not be easily tilted or knocked over.
6. Liquid or solid fueled lighting devices containing more than 8 ounces must be self extinguishing and not leak more than one fourth teaspoon per minute if tipped over.
7. The device or holder shall be constructed to prevent the spilling of liquid fuel or wax at the rate of more than one fourth teaspoon per minute when the device or holder is in a position other than the upright position.
8. Shades, if used, shall be made of noncombustible materials and securely attached to the open flame device holder of chimney.
9. Candelabras with flame-lighted candles shall be securely fastened in place to prevent overturning and located away from occupants using the area and away from possible contact with drapes, curtains or other combustibles.