


POSTED DISCLOSURE INFORMATION

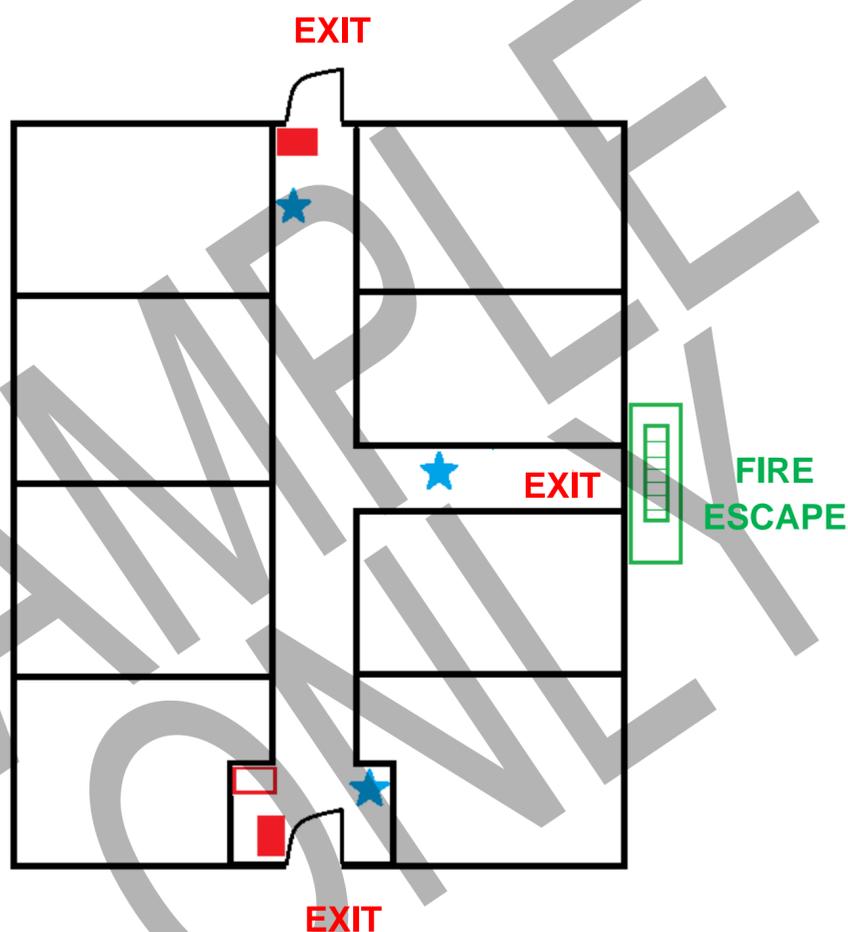

EXITS SHALL REMAIN UNOBSTRUCTED AT ALL TIMES!!!

- -FIRE ALARM PULL STATION
- ★ -FIRE EXTINGUISHER _____ (Service Date)
- -FIRE ALARM PANEL _____ (Service Date)
UL CERTIFICATE # _____
UL EXPIRATION DATE _____
- ▭ -FIRE ESCAPE _____ (Service Date)

FIRE DEPARTMENT VIOLATION
HOTLINE 415-558-3300