



|          |            |
|----------|------------|
| File No: | [REDACTED] |
| CCN:     | UUKF       |
| Issued:  | 4/26/2023  |
| Revised: | 4/26/2023  |

## ERCES CERTIFICATE

**Protected Property:**

[REDACTED]  
 San Francisco, CA 94109 UNITED STATES

**ERCES Company:**

[REDACTED]

**System Description:**

|  |                                  |
|--|----------------------------------|
| Area Covered:                          | Entire Building                  |
| Testing and Maintenance Contract Date: | 4/26/2023                        |
| Authority Having Jurisdiction:         | San Francisco Fire Department    |
| Responding Fire Department:            | San Francisco Fire Department    |
| FCC License Holder:                    | City and County of San Francisco |

|   |                 |
|---|-----------------|
| Model Code                              | CFC 2019        |
| UL Listed (UL 2524)                     | Yes             |
| ETL/SGS/Other NRTL Listed (UL 2524)     | Yes             |
| Booster Type                            | Class A         |
| FCC License Holder Rebroadcast          | Yes             |
| Letter/Approval                         |                 |
| Erces Control Panel/System Manufacturer | Comba           |
| Erces Control Panel/System Model        | RX78V1-A3348-UL |
| Lightning Protection                    | Yes             |
| Pathway Survivability                   | 2 Hours         |
| General Coverage Area                   | 95%             |
| Elevator Lobbies                        | 99%             |
| Exit Stairwells                         | 99%             |
| Exit Passageways                        | 99%             |
| Standpipe / Hose Cabinets               | 99%             |
| Fire Pump Room                          | 99%             |
| Command Center                          | N/A             |

**SYSTEM DEVIATIONS FROM REFERENCED NFPA STANDARDS**


NONE

**ERCES Deployment:**

|                   |    |
|-------------------|----|
| Antenna(s):       | 11 |
| Donor Antenna(s): | 1  |

**Monitoring Location:**

**AHJ Approved Alternate Location**

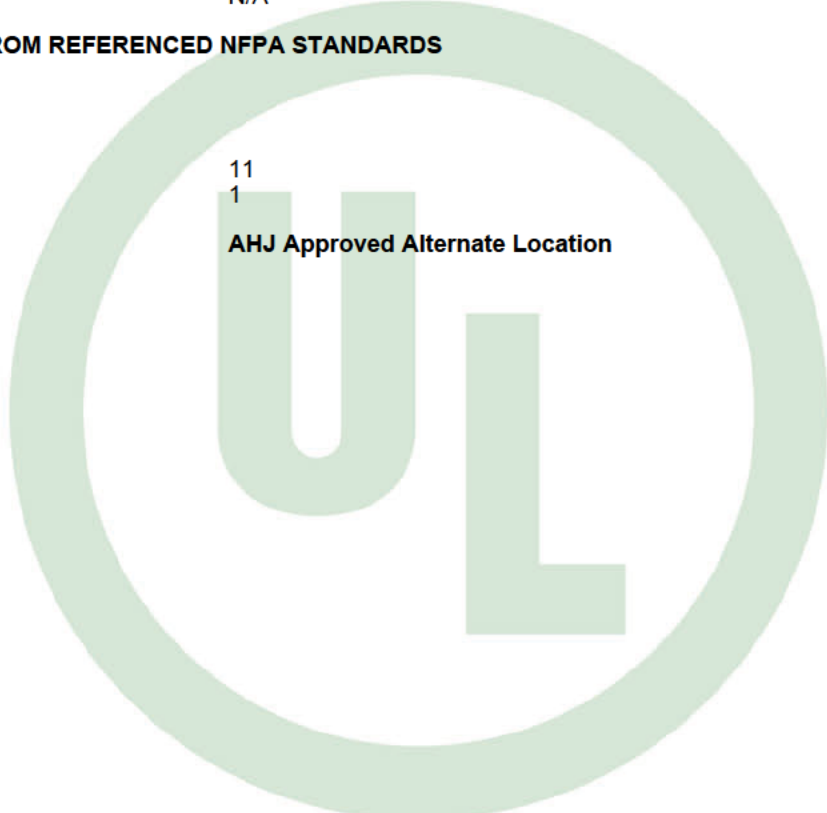

**SN:** [REDACTED].230426